



City of Long Branch
Office of the Fire Official
344 Broadway
Long Branch, New Jersey 07740

Phone: 732-571-5651

Fax: 732-222-4493

Fire Extinguishers – No Longer Required

As of February 3, 2025, portable fire extinguishers are no longer required to obtain a CSACMAPFEC in Long Branch. Homeowners and property sellers are no longer obligated to install fire extinguishers as part of the compliance inspection process.

Secondary Power Source Identification Label

As of February 3, 2025, all one- and two-family and attached single-family dwellings with a secondary power source must have a Secondary Power Source Identification Label installed within 18 inches of the main electrical panel and electrical meter when there is a change of occupancy.

- This applies to homes:
 - Permanently installed internal combustion generators
 - Solar panels
 - Battery storage systems
 - Any other supplemental electrical energy source
- Label Requirements:
 - Clearly marked with: "CAUTION: MULTIPLE SOURCES OF POWER." or similar verbiage.
 - Not handwritten
 - Compliant with ANSI Z535.4 labeling standards

Important Notice: This regulation was introduced as part of a recent update to the Fire Safety Act. Further guidance from the New Jersey Division of Fire Safety may be issued, and this document will be updated accordingly.




City of Long Branch
Office of the Fire Official
344 Broadway
Long Branch, New Jersey 07740

Phone: 732-571-5651

Fax: 732-222-4493

Smoke and Carbon Monoxide Alarms Location Examples

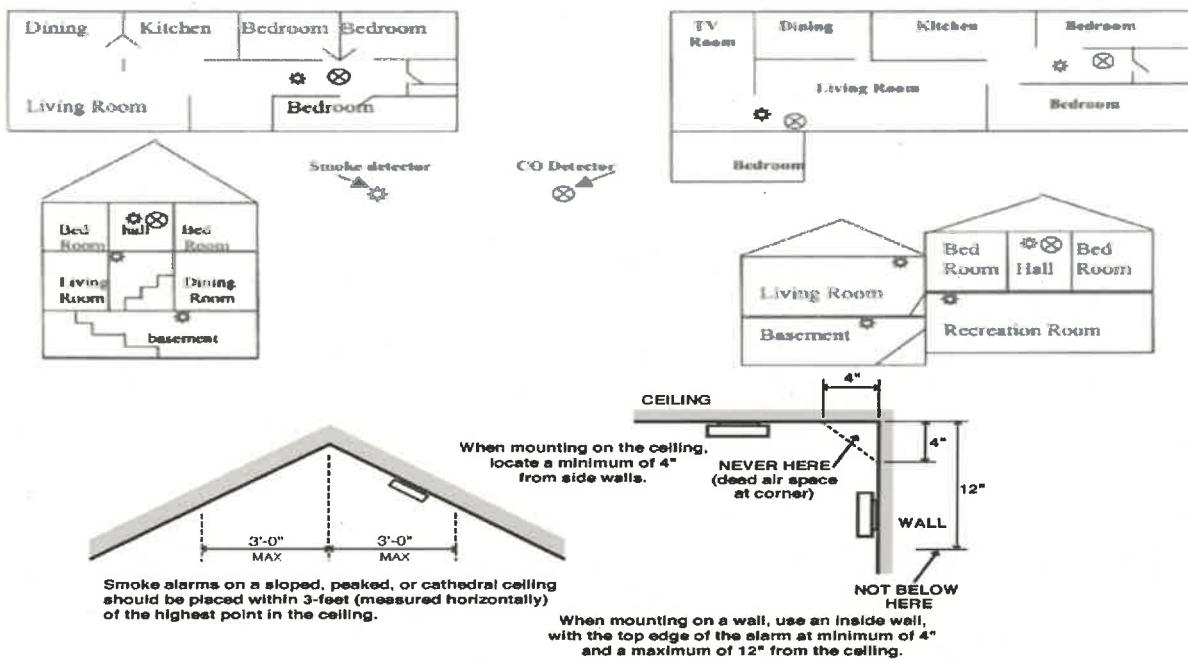

Secondary Power Source Identification Label

